


# AES Ohio 345kV Typical Structures

Structures are for visual representation purposes only and are not drawn to scale.  
Structure heights, widths, and configurations will vary depending on terrain and other engineering factors.

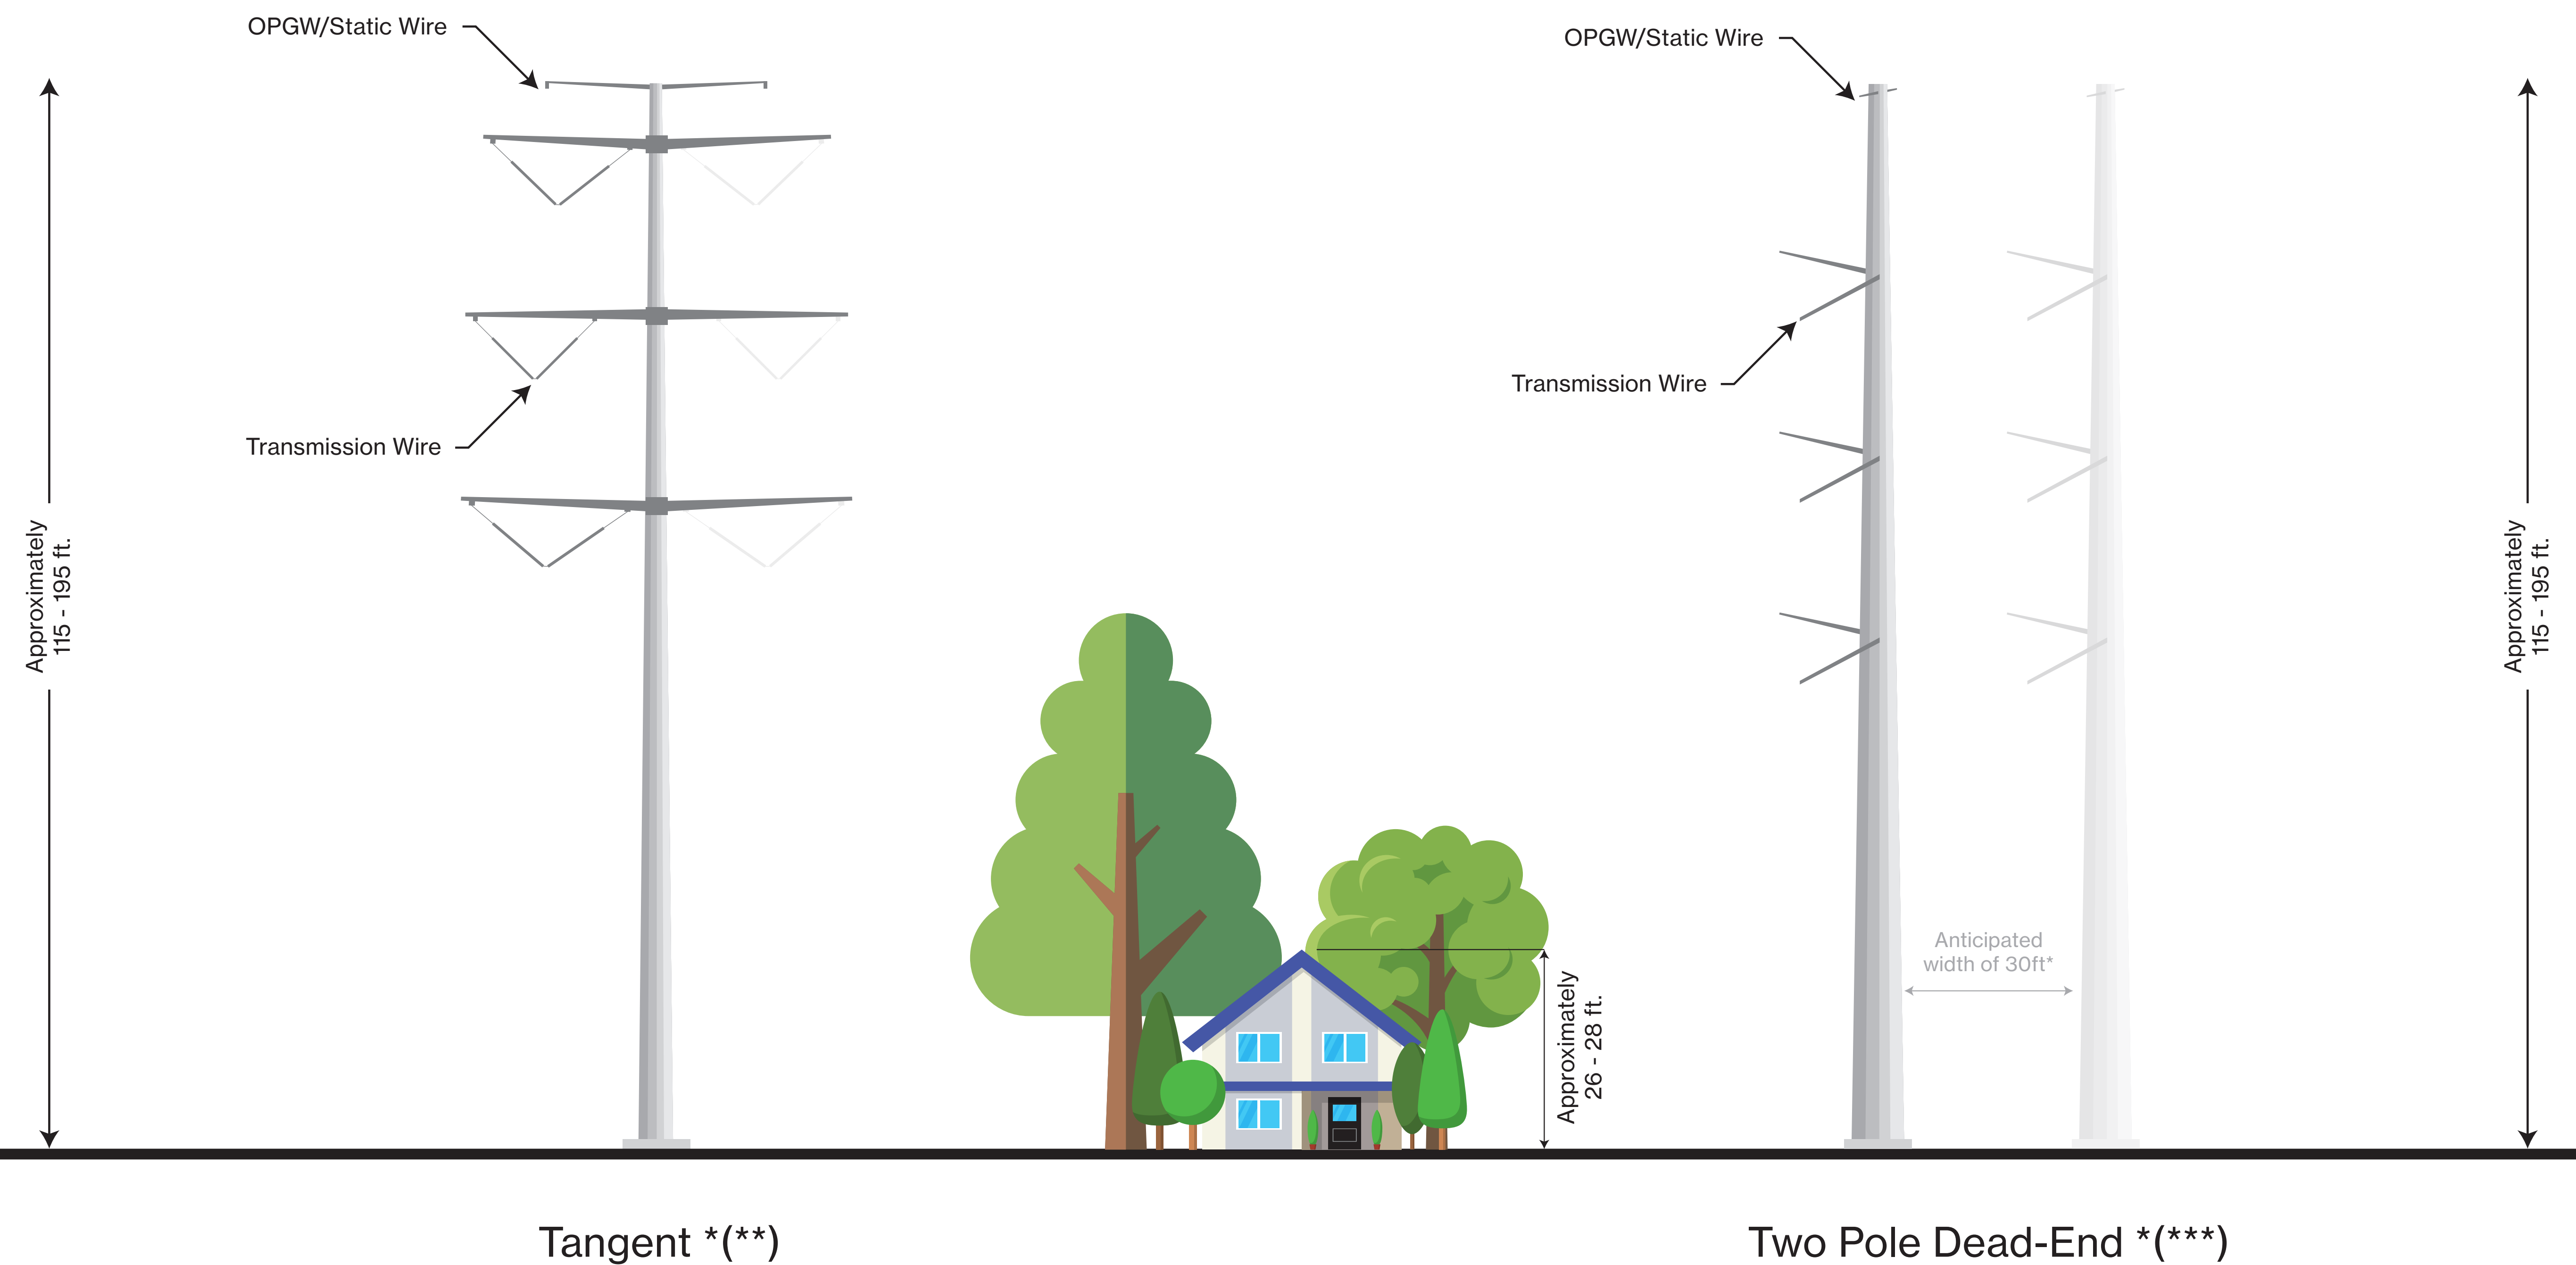

\* Final structure height, structure type, and ROW easement width may vary.  
\*\* A second circuit may be added to tangent structures if required for future project updates.  
\*\*\* A second pole may be added at turn angles if required for future project updates.